


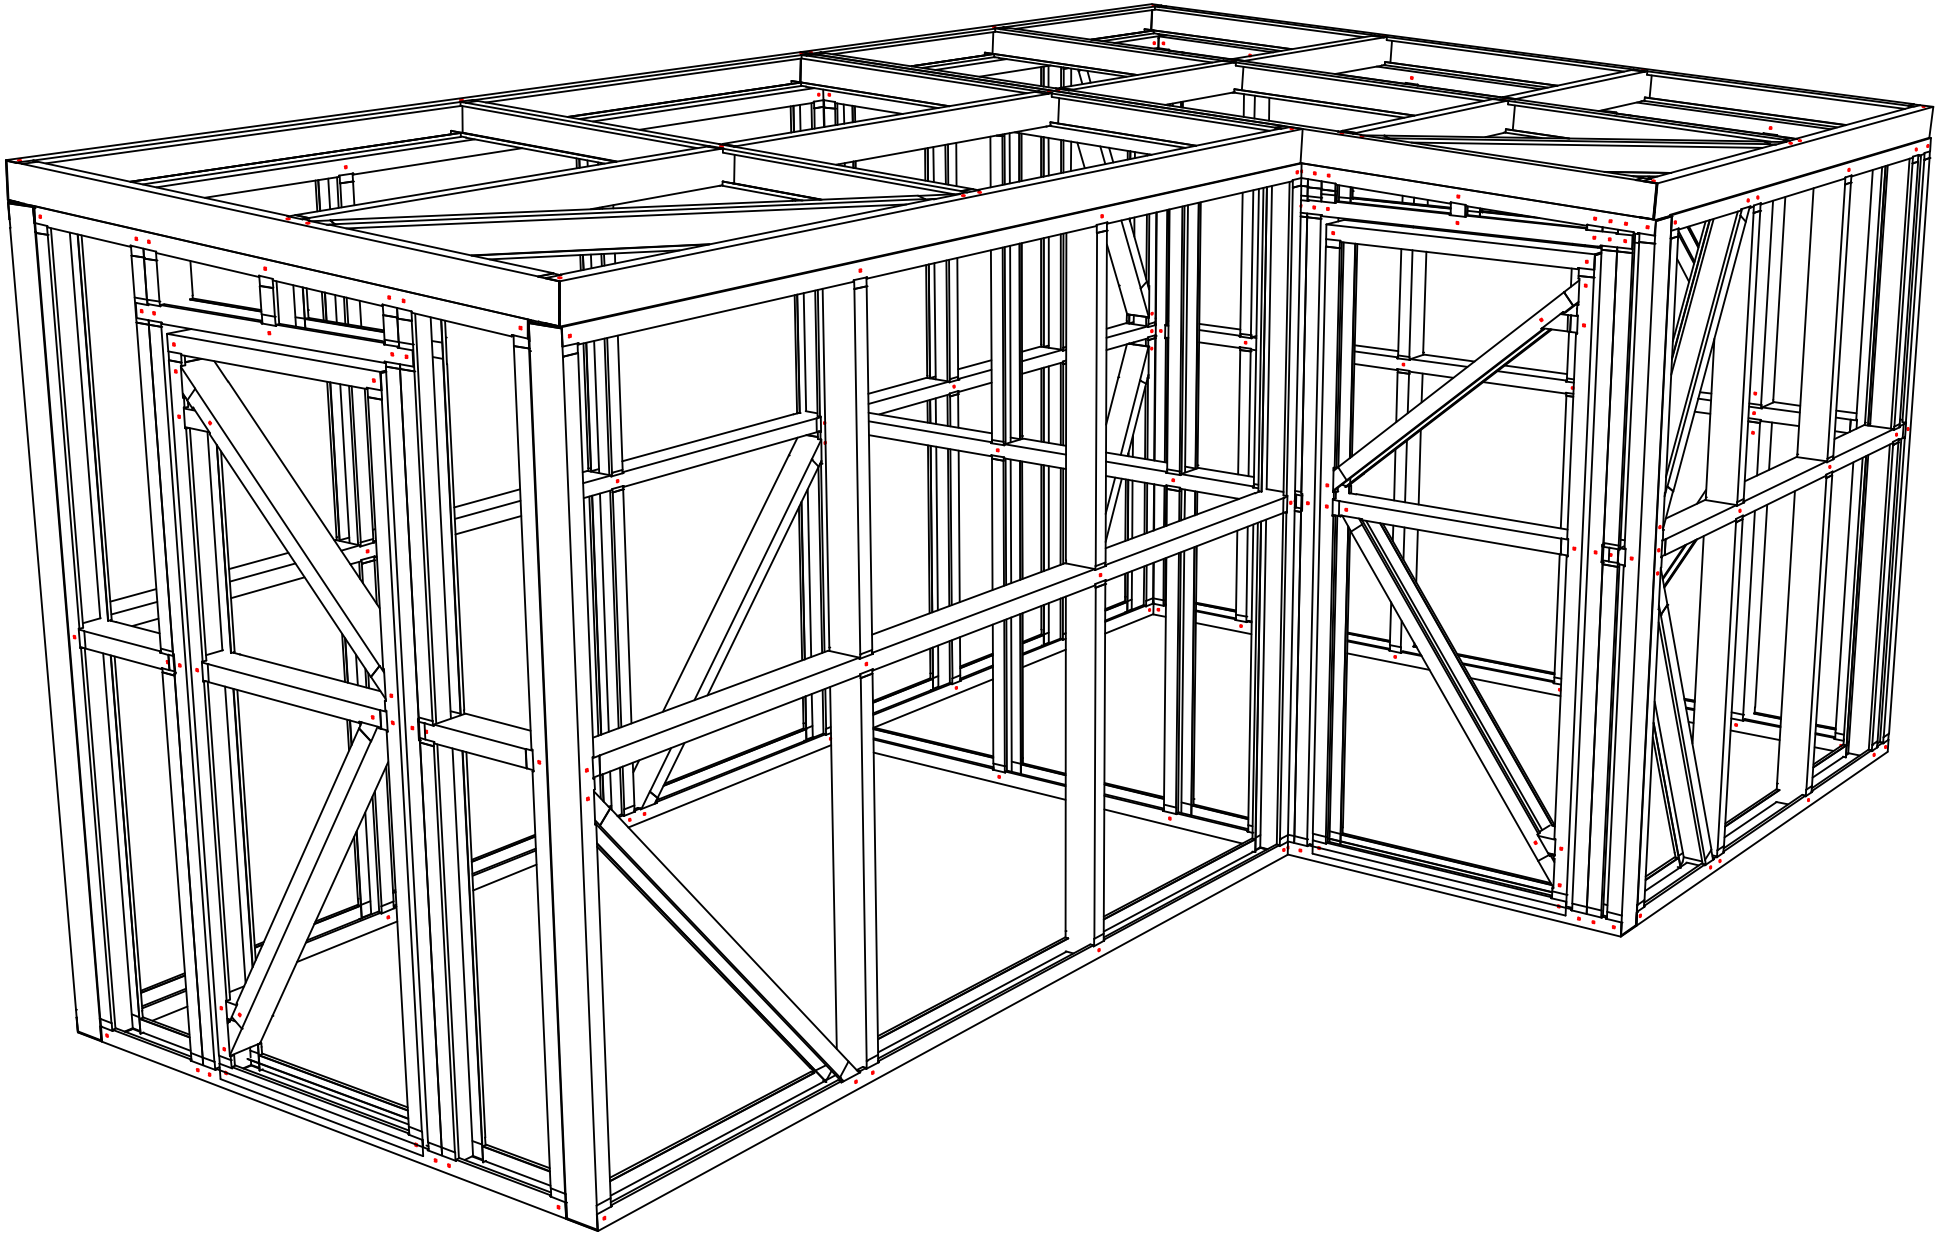

PROPOSED NEW DESIGN FOR
OD-003 Glass House / Shed

SITE ADDRESS
TBC
TBC

STEEL FRAME CONSTRUCTION PLANS



DESIGN PARAMETERS		COVER SHEET	CONSTRUCTION DRAWING SET	
WIND ZONE	--	JOB NUMBER GH-2.7x4.5-A	ISSUE DATE 11.10.2022	
SNOW ZONE	--			
EARTHQUAKE ZONE	--			
LOT #	-- DP			

REVISION
A

NOTES ON COLD FORMED STEEL FABRICATION AND ERECTION All cold formed steel structure design is to NZ standards or certified by suitably qualified persons prior to construction. Refer to architectural drawings for dimensions, foundations and any structural steel not shown on framing drawings. FRAMING All framing members to be type SC/PC as classified by 'NASH Standard Part Two: May 2019', Tables E1 & E2, UNO. Framing components are to be pre-assembled into panels prior to erecting and will be square with components attached in a manner to avoid raking. Design, fabrication and erection shall comply with NASH SP2:2019. All screws to be 10g tek screws UNO. Splices in studs of load bearing walls are not permitted. Members shall be held positively in place until properly fastened. ERECTION Erect framing and panels level and square in strict accordance with the approved shop drawings. Handling and lifting of prefabricated panels shall be done in a manner as to not cause distortion in a member. Concrete anchors shall be installed after full concrete compressive strength has been achieved. Do not cut load bearing studs, lintels or trusses to install services in excess of a 35mm diameter hole at the centre of a member, unless studs have been reinforced to maintain structural integrity as per details provided. Ensure continuous DPC between any Concrete, Copper, Brass, CCA treated timber and galvanised steel. Builder to check all trim sizes, braces and cladding fixings on site before enclosing. FIXINGS Screw fixings shall be a minimum of 1.5x the diameter of the screw shank from the closest end and edge of the members being connected except for battens that shall be a minimum of 3x the diameter of the screw shank from the closest end of the batten being connected. Minimum spacing crs between screw fixings shall be 3x the diameter of the screw shank. Screw fixings into timber shall be a minimum of 4x the diameter of the screw shank from any edges and ends of the timber member. Screws shall have a minimum of 3 threads penetration through the connection. Please note Steel Frame Manufacturing Ltd only supplies frame to frame connections unless otherwise agreed.



SFML
STEEL FRAME MANUFACTURING LIMITED
steelframeman.co.nz | 0800 178 335 | 29 Studholme St, Waimate

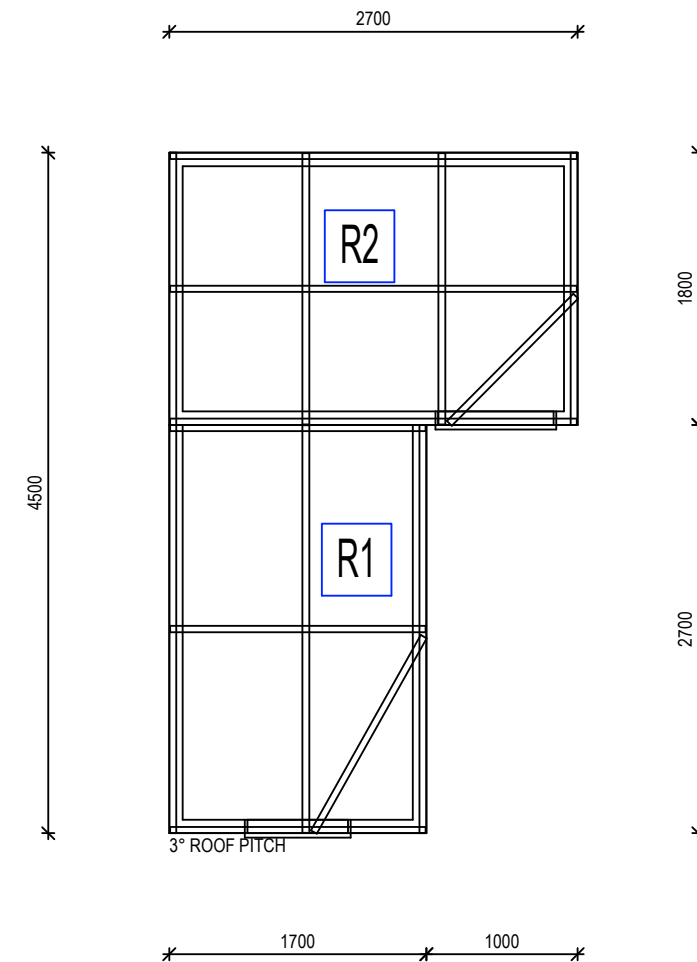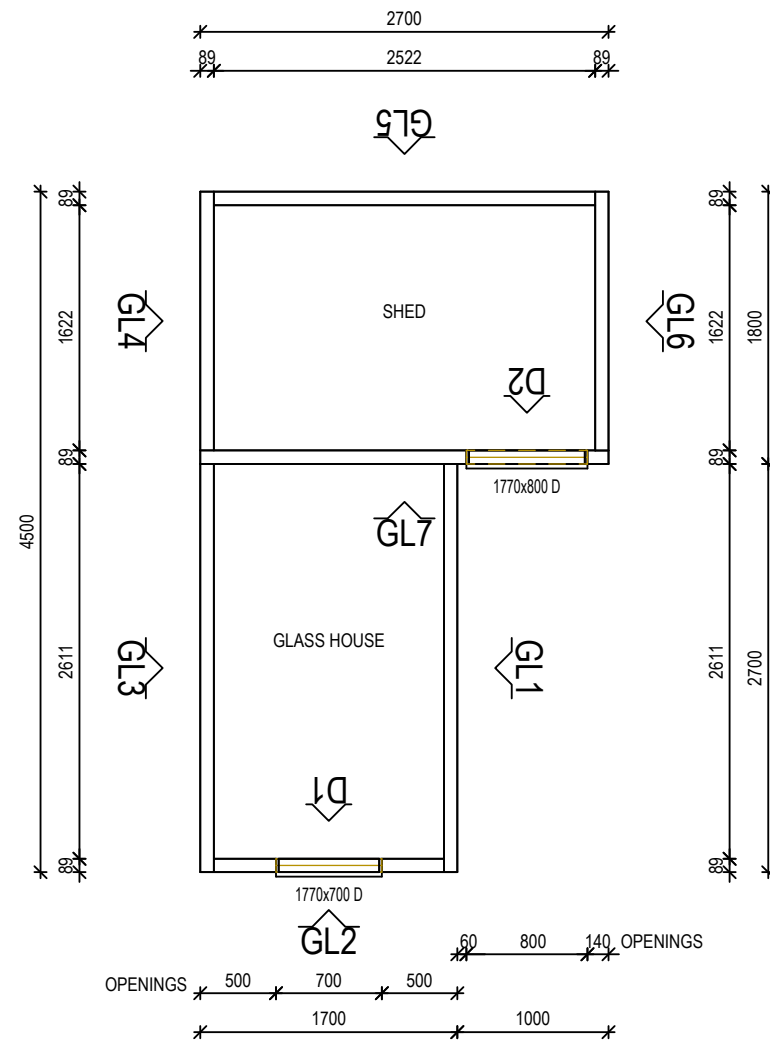

WALL FRAME NOTES

1. DESIGN OUTSIDE OF SCOPE OF NASH-SP2:2019

READING THE WALL FRAME LAYOUT PLAN

WALL PANEL ORIENTATION:

Each wall panel will have the frame code printed on one side of the frame and the Steel Frame Manufacturing Limited website printed on the other. The side with the frame code is the side that the label points to on the plan.

All external walls should have the frame code facing out.

STEELFRAMEMAN.CO.NZ

FRAME CODE



PROPOSED NEW DESIGN FOR
OD-003 Glass House / Shed

SITE ADDRESS
TBC
TBC

DESIGN PARAMETERS

WIND ZONE	--
SNOW ZONE	--
EARTHQUAKE ZONE	--
LOT #	--
DP	--

STEEL FRAME CONSTRUCTION PLANS

FRAME LAYOUT

CONSTRUCTION

C01

JOB NUMBER
GH-2.7x4.5-A





ISSUE DATE
11.10.2022

info@steelframeman.co.nz

DETAILER: CT

A	REVISION
---	----------



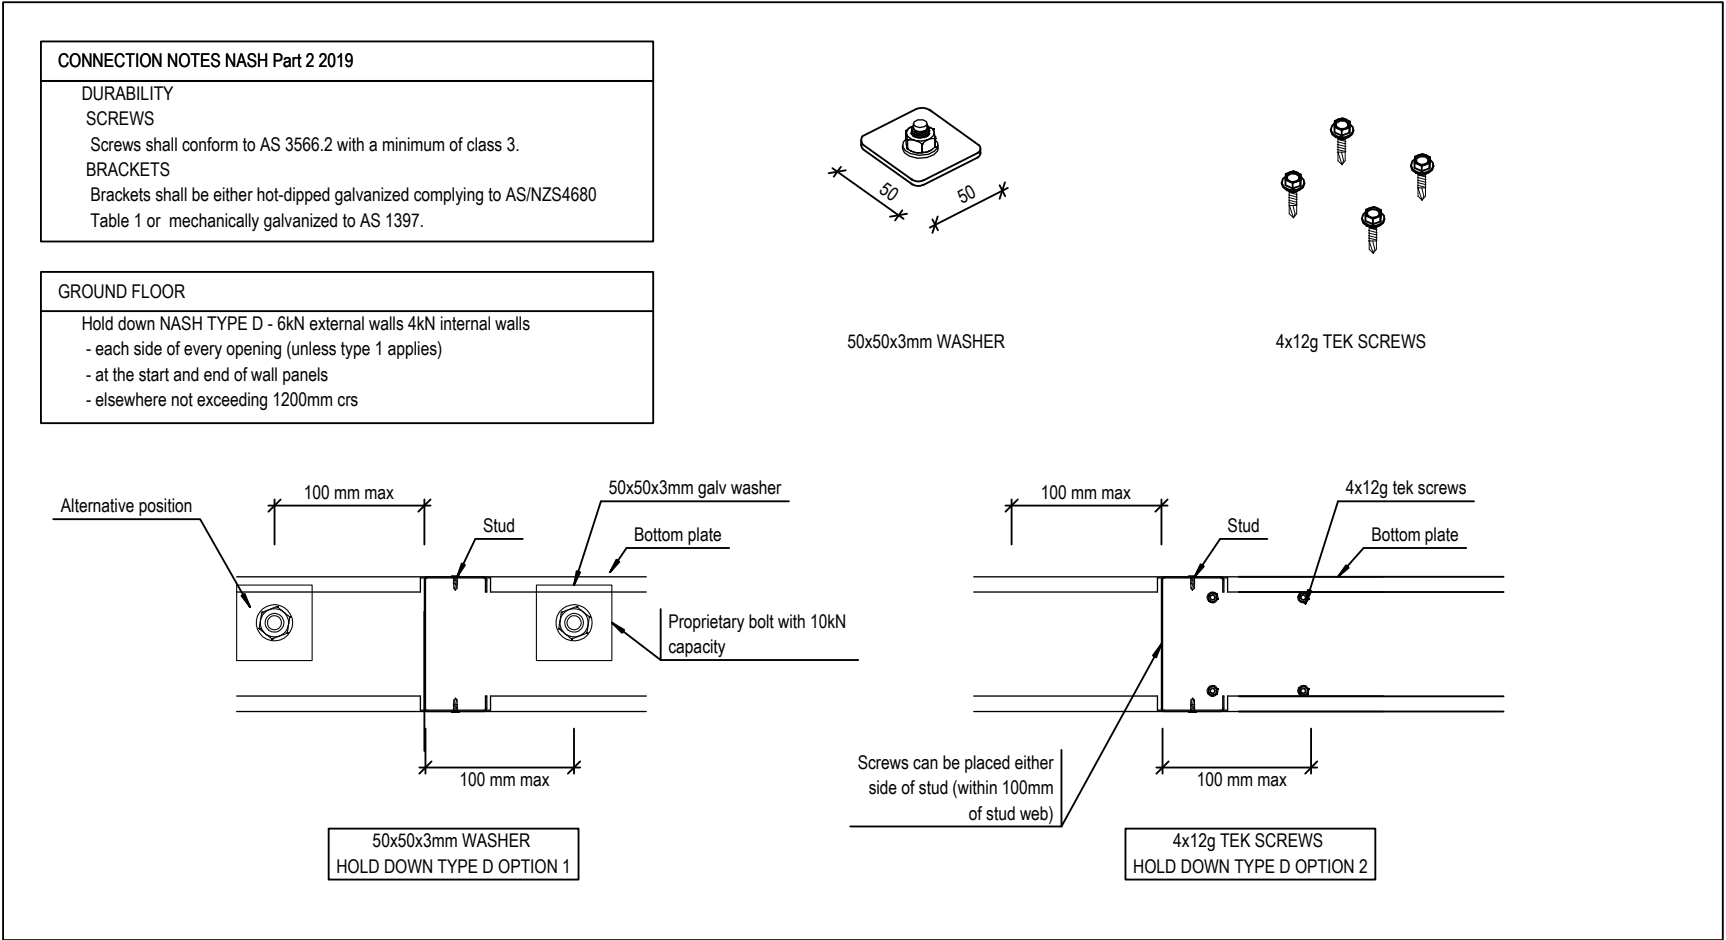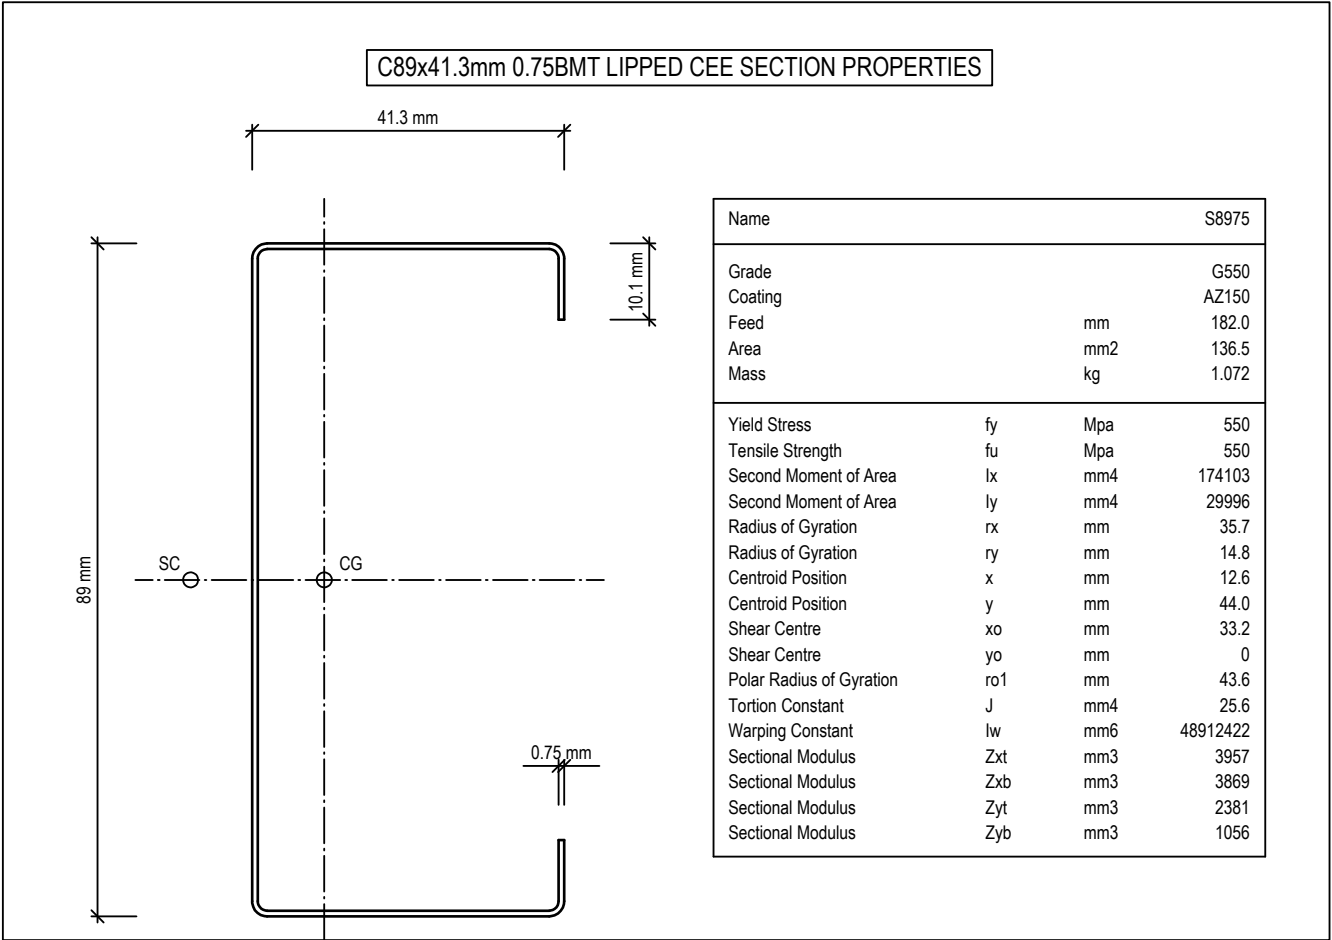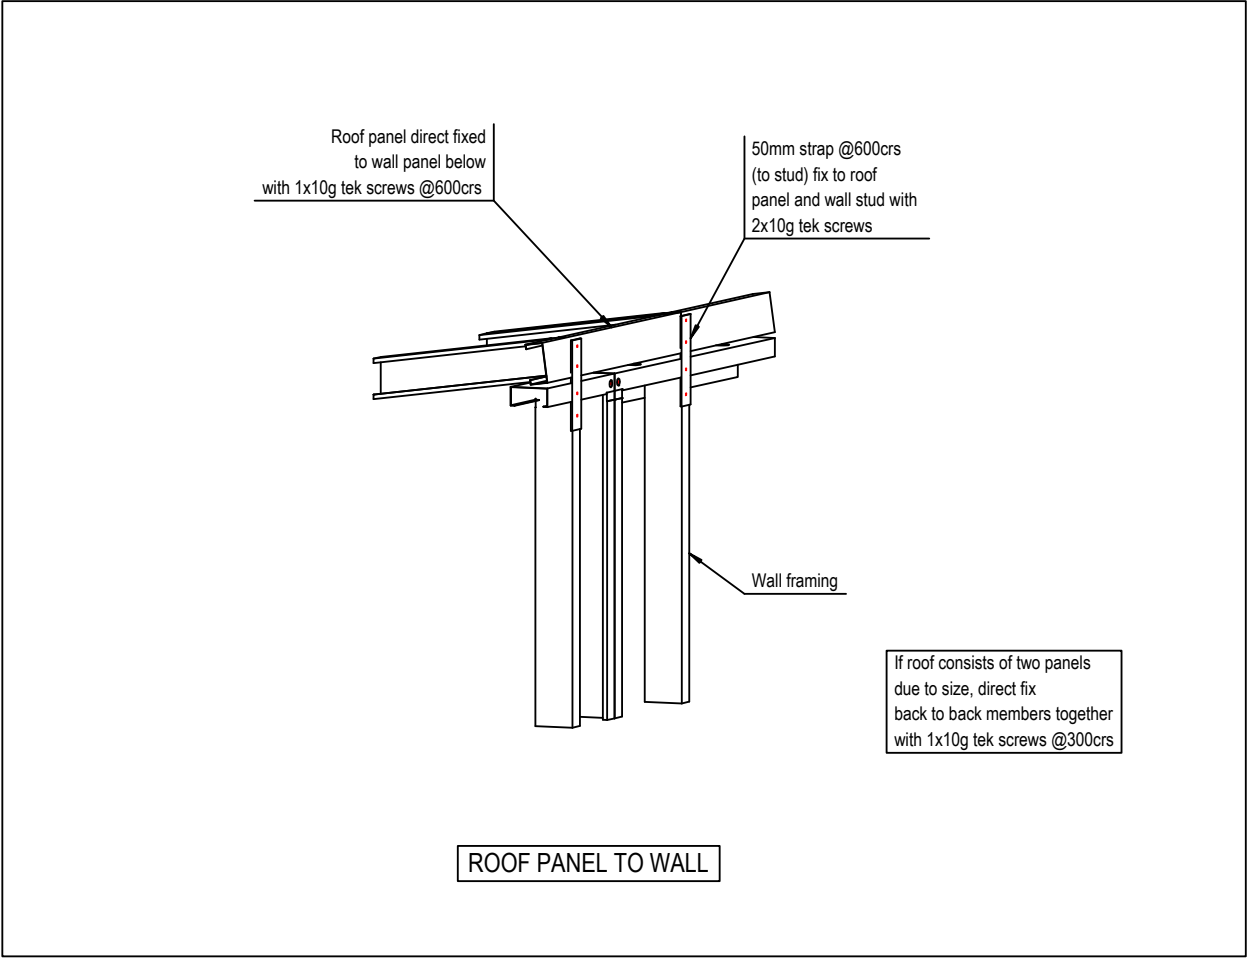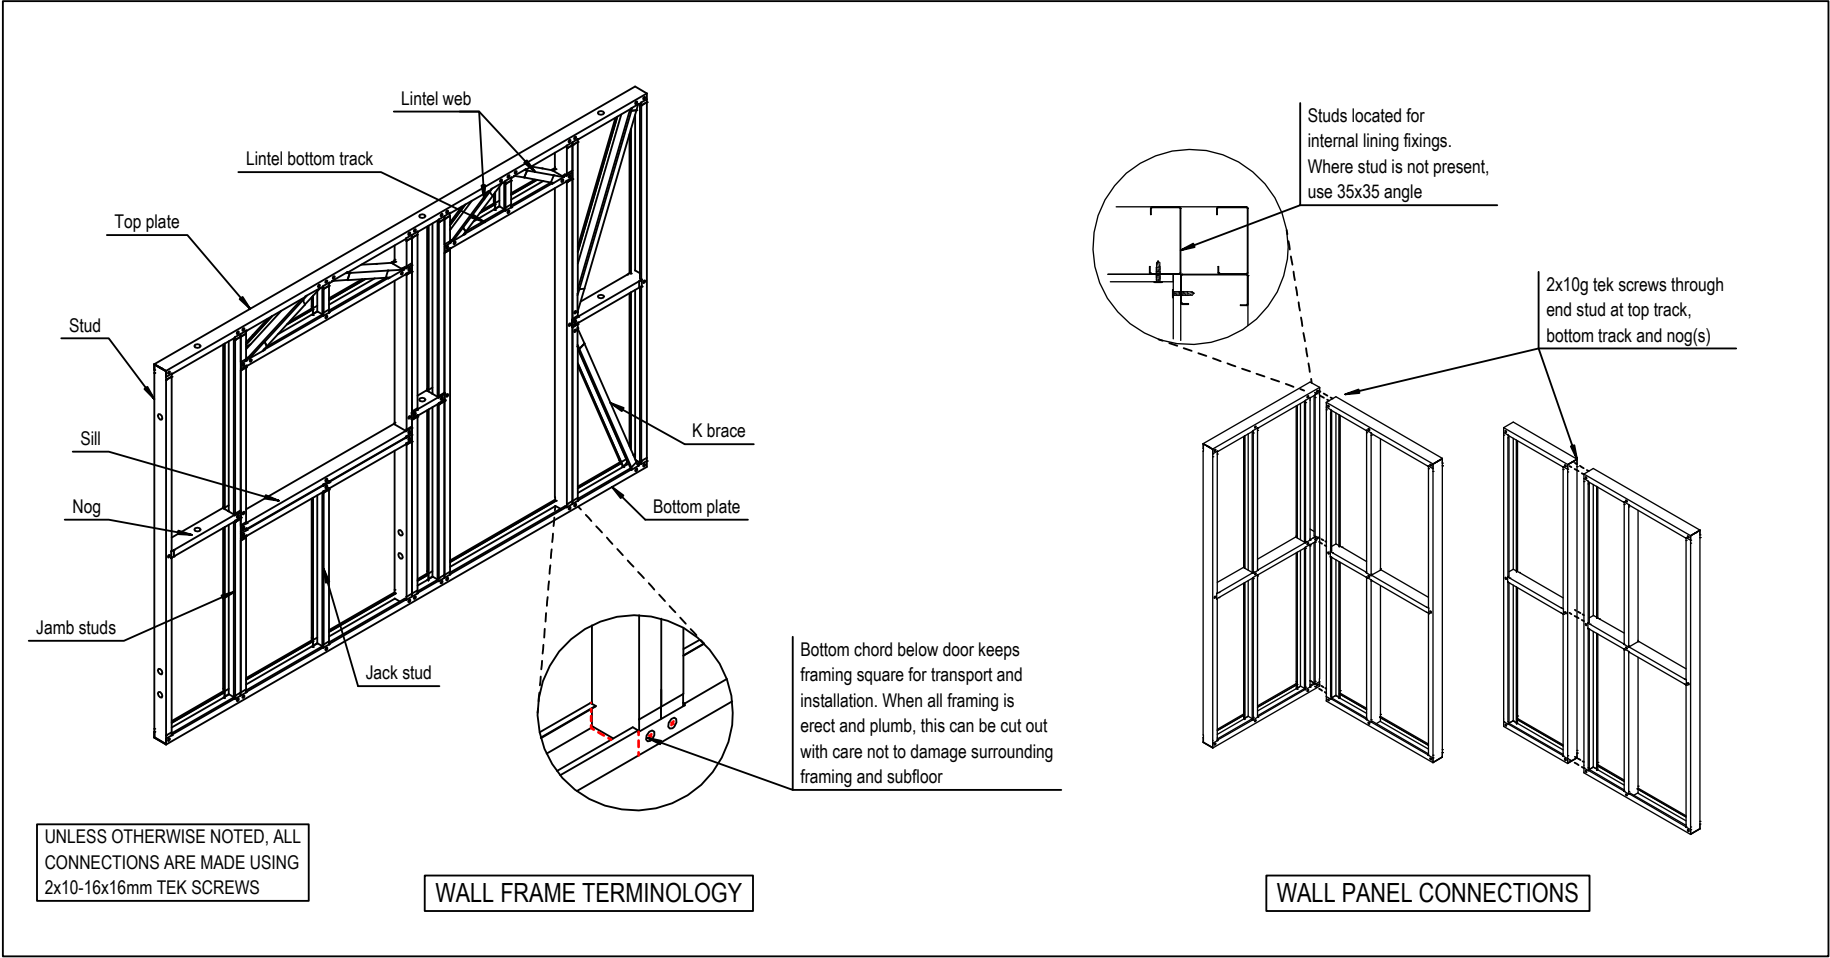

PROPOSED NEW DESIGN FOR OD-003 Glass House / Shed	DESIGN PARAMETERS	STEEL FRAME CONSTRUCTION PLANS DETAILS	CONSTRUCTION	C02	REVISION A	 STEEL FRAME MANUFACTURING LIMITED steelframeman.co.nz 0800 178 335 29 Studholme St, Waimate
	SITE ADDRESS TBC TBC		WIND ZONE -- SNOW ZONE -- EARTHQUAKE ZONE -- LOT # -- DP --	JOB NUMBER GH-2.7x4.5-A info@steelframeman.co.nz		