


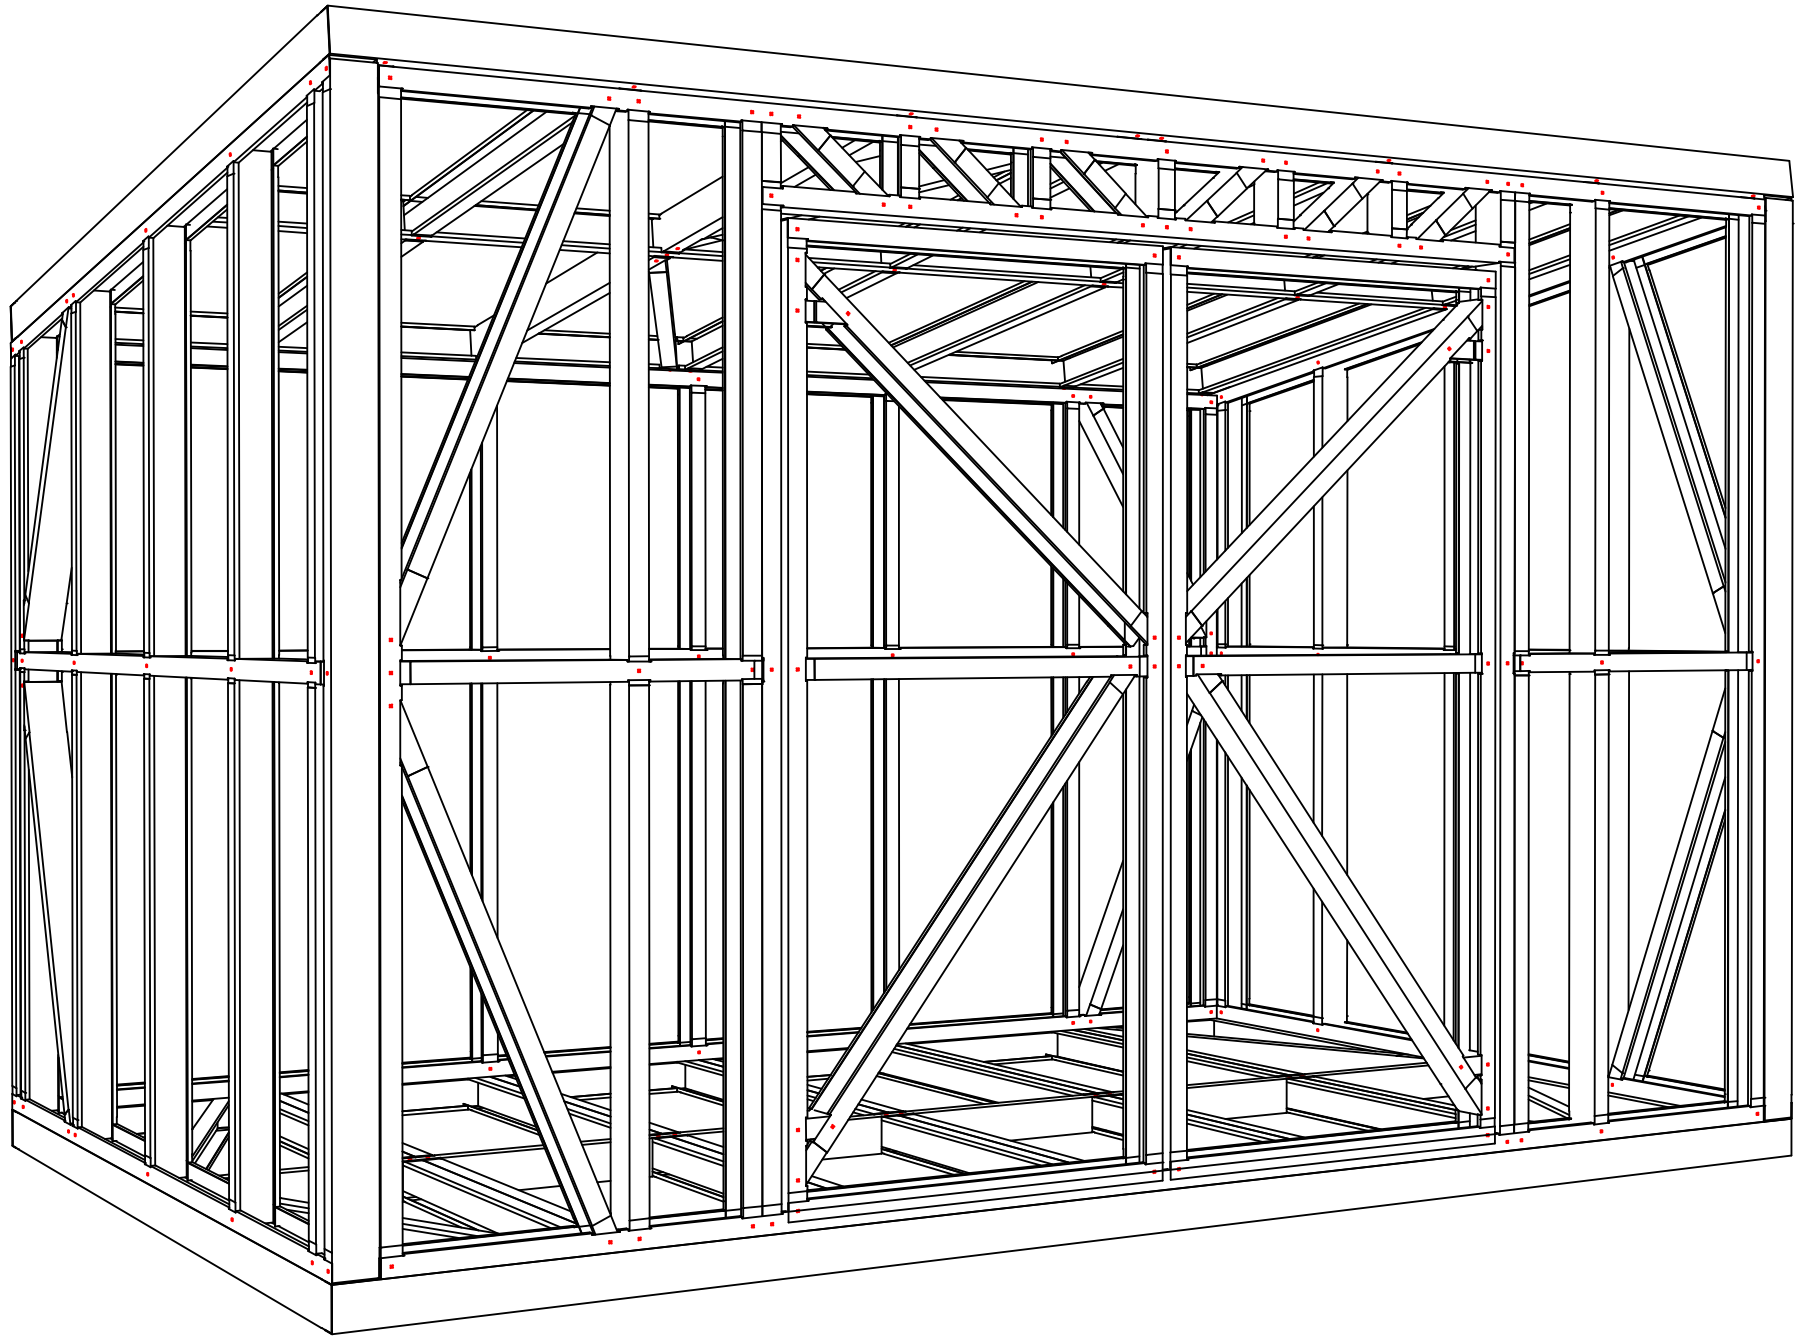

PROPOSED NEW DESIGN FOR
SH-2.4x3.6-A

SITE ADDRESS
TBC

STEEL FRAME CONSTRUCTION PLANS

DESIGN PARAMETERS	
WIND ZONE	EH
SNOW ZONE	<1.5kPa
EARTHQUAKE ZONE	--
LOT #	-- DP

COVER SHEET

JOB NUMBER
SH-2.4x3.6-A+

CONSTRUCTION DRAWING SET




ISSUE DATE
18.11.2024

REVISION
A

NOTES ON COLD FORMED STEEL FABRICATION AND ERECTION All cold formed steel structure design is to NZ standards or certified by suitably qualified persons prior to construction. Refer to architectural drawings for dimensions, foundations and any structural steel not shown on framing drawings. FRAMING All framing members to be type SC/PC as classified by 'NASH Standard Part Two: May 2019', Tables E1 & E2, UNO. Framing components are to be pre-assembled into panels prior to erecting and will be square with components attached in a manner to avoid raking. Design, fabrication and erection shall comply with NASH SP2:2019. All screws to be 10g tek screws UNO. Splices in studs of load bearing walls are not permitted. Members shall be held positively in place until properly fastened. ERECTION Erect framing and panels level and square in strict accordance with the approved shop drawings. Handling and lifting of prefabricated panels shall be done in a manner as to not cause distortion in a member. Concrete anchors shall be installed after full concrete compressive strength has been achieved. Do not cut load bearing studs, lintels or trusses to install services in excess of a 35mm diameter hole at the centre of a member, unless studs have been reinforced to maintain structural integrity as per details provided. Ensure continuous DPC between any Concrete, Copper, Brass, CCA treated timber and galvanised steel. Builder to check all trim sizes, braces and cladding fixings on site before enclosing. FIXINGS Screw fixings shall be a minimum of 1.5x the diameter of the screw shank from the closest end and edge of the members being connected except for battens that shall be a minimum of 3x the diameter of the screw shank from the closest end of the batten being connected. Minimum spacing crs between screw fixings shall be 3x the diameter of the screw shank. Screw fixings into timber shall be a minimum of 4x the diameter of the screw shank from any edges and ends of the timber member. Screws shall have a minimum of 3 threads penetration through the connection. Please note Steel Frame Manufacturing Ltd only supplies frame to frame connections unless otherwise agreed.



SFML
STEEL FRAME MANUFACTURING LIMITED
steelframeman.co.nz | 0800 178 335 | 29 Studholme St, Waimate

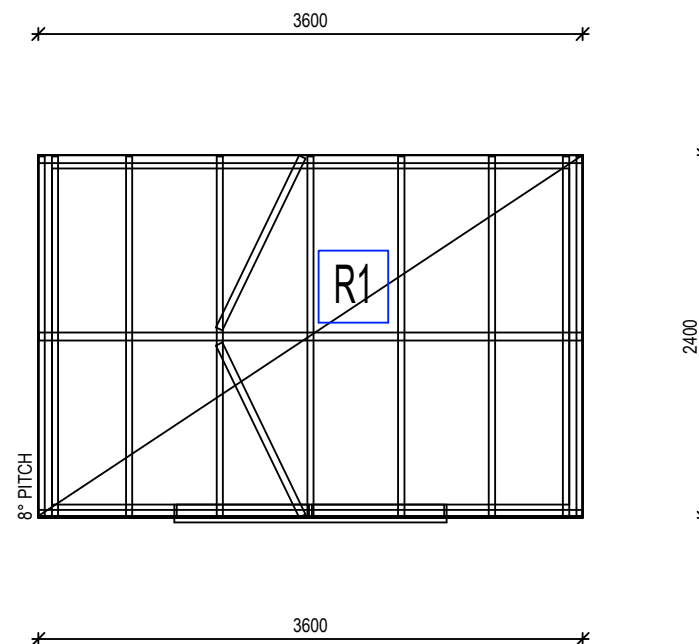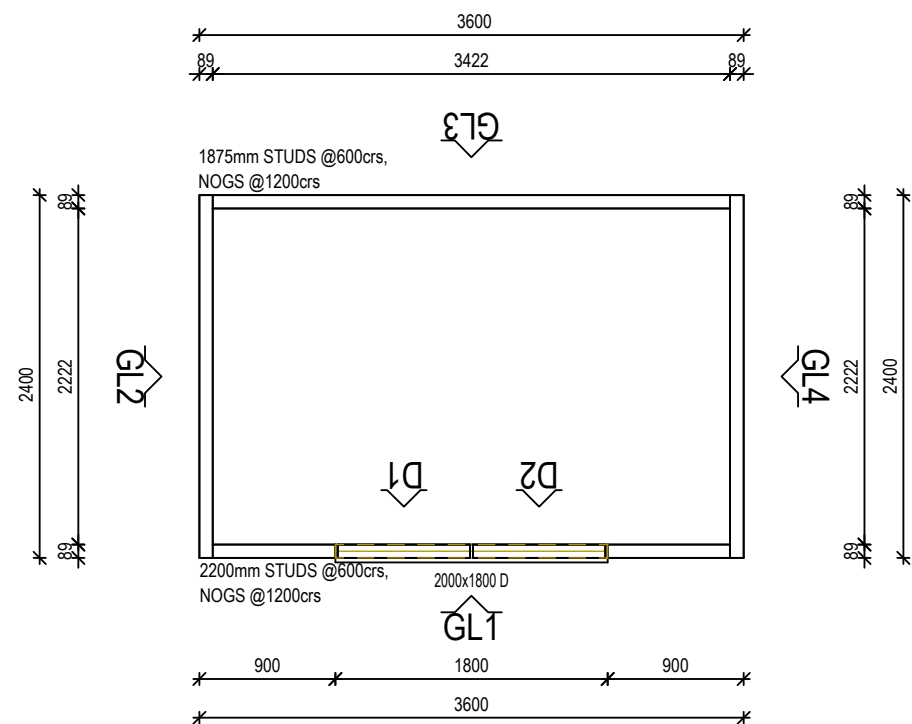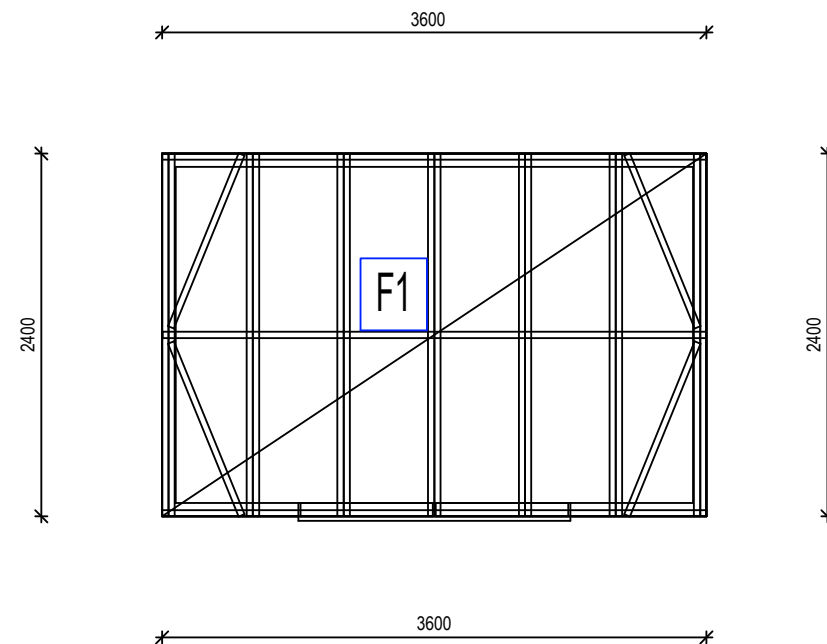

FRAME DESIGN NOTES

1. WALL DESIGN IN ACCORDANCE WITH NASH STANDARD PART TWO: MAY 2019
 - Loadbearing openings to have min 2x jamb studs in accordance with table 7.15
 - Loadbearing lintels min 180mm TYPE A2 in accordance with table 11.9
 - Stud spacing and stud to plate connections in accordance with tables 7.4 and 7.5
2. RAFTER DESIGN IN ACCORDANCE WITH NASH STANDARD PART TWO: MAY 2019
 - Rafter spans in accordance with table 11.1
3. BRACING DESIGN EXCLUDED/BY OTHERS
4. FLOOR DESIGN OUTSIDE OF NASH SCOPE

READING THE WALL FRAME LAYOUT PLAN

WALL PANEL ORIENTATION:

Each wall panel will have the frame code printed on one side of the frame and the Steel Frame Manufacturing Limited website printed on the other. The side with the frame code is the side that the label points to on the plan.

All external walls should have the frame code facing out.

STEELFRAMEMAN.CO.NZ

FRAME CODE

GL1

PROPOSED NEW DESIGN FOR
SH-2.4x3.6-A

SH-2.4x3.6-A

SITE ADDRESS
TBC

TBC

DESIGN PARAMETERS

WIND ZONE	EH
SNOW ZONE	<1.5kPa
EARTHQUAKE ZONE	--
LOT #	--
DP	--

STEEL FRAME CONSTRUCTION PLANS

FRAME LAYOUT

FRAME LAYOUT

CONSTRUCTION

C01

JOB NUMBER

SH-2.4x3.6-A+

info@steelframeman.co.nz

ISSUE DATE





18.11.2024

DETAILER: CT

REVISION	
----------	--

A



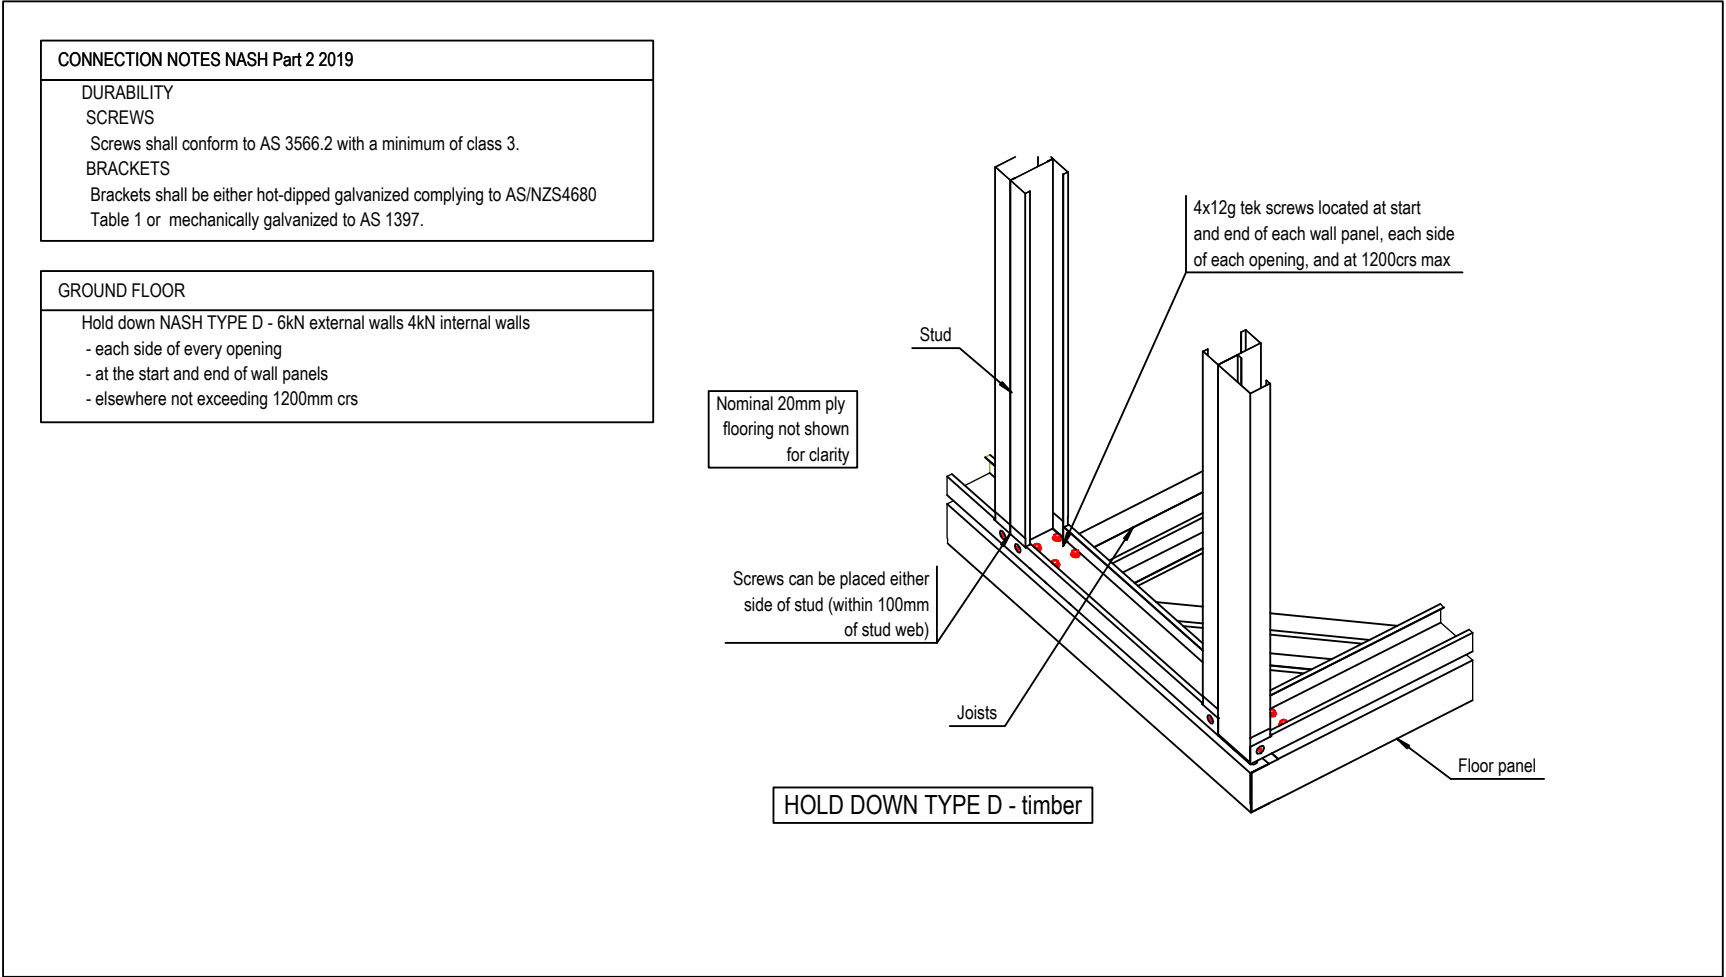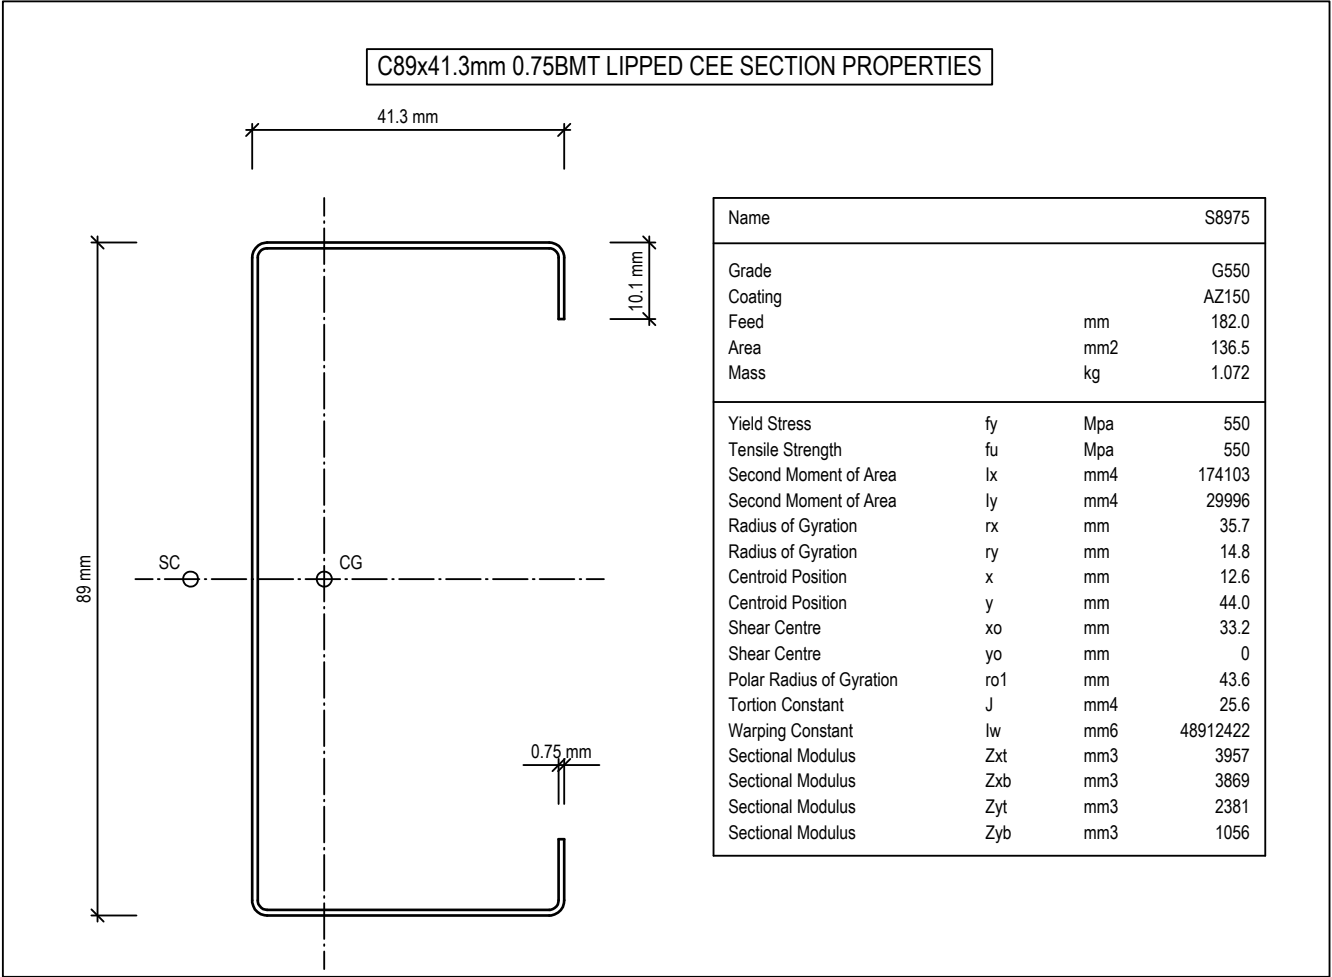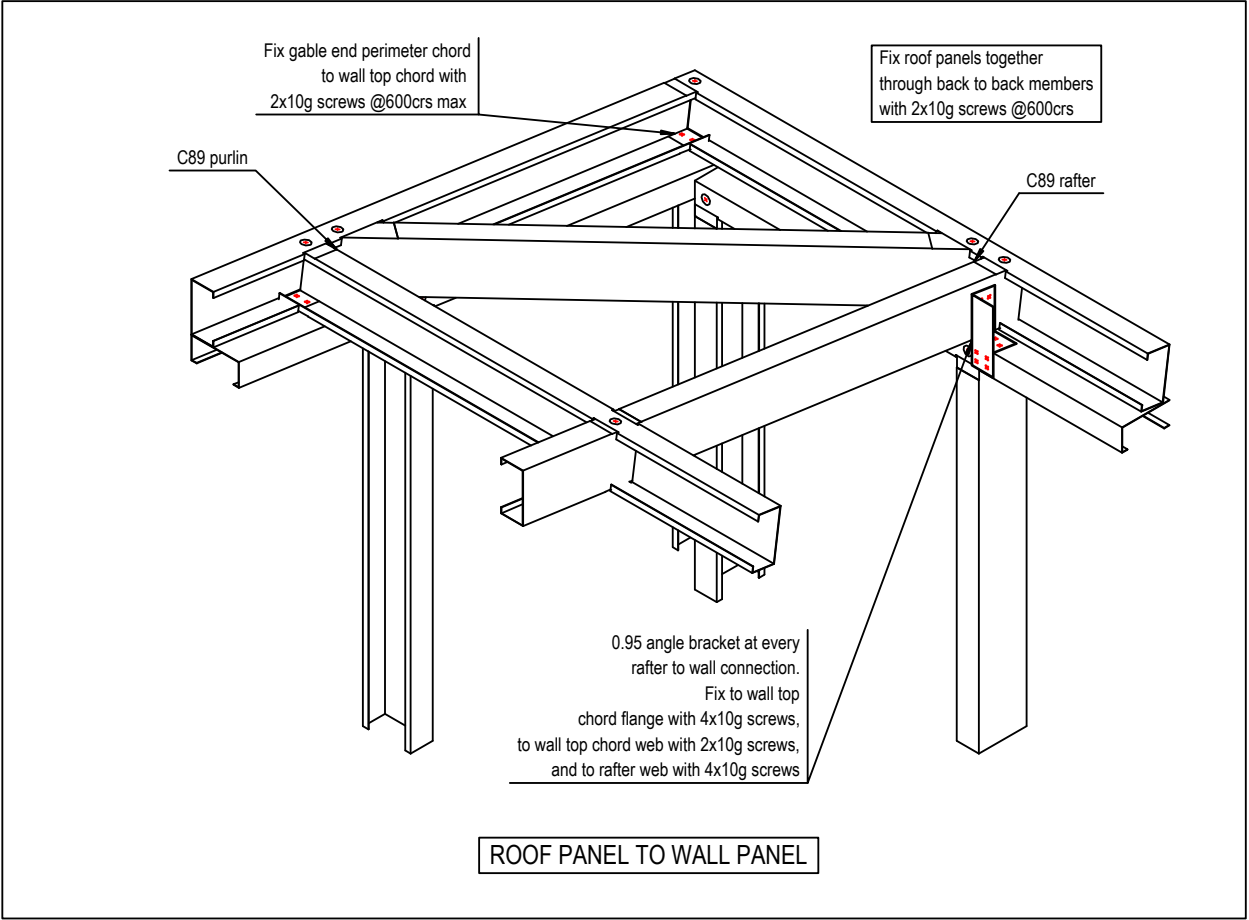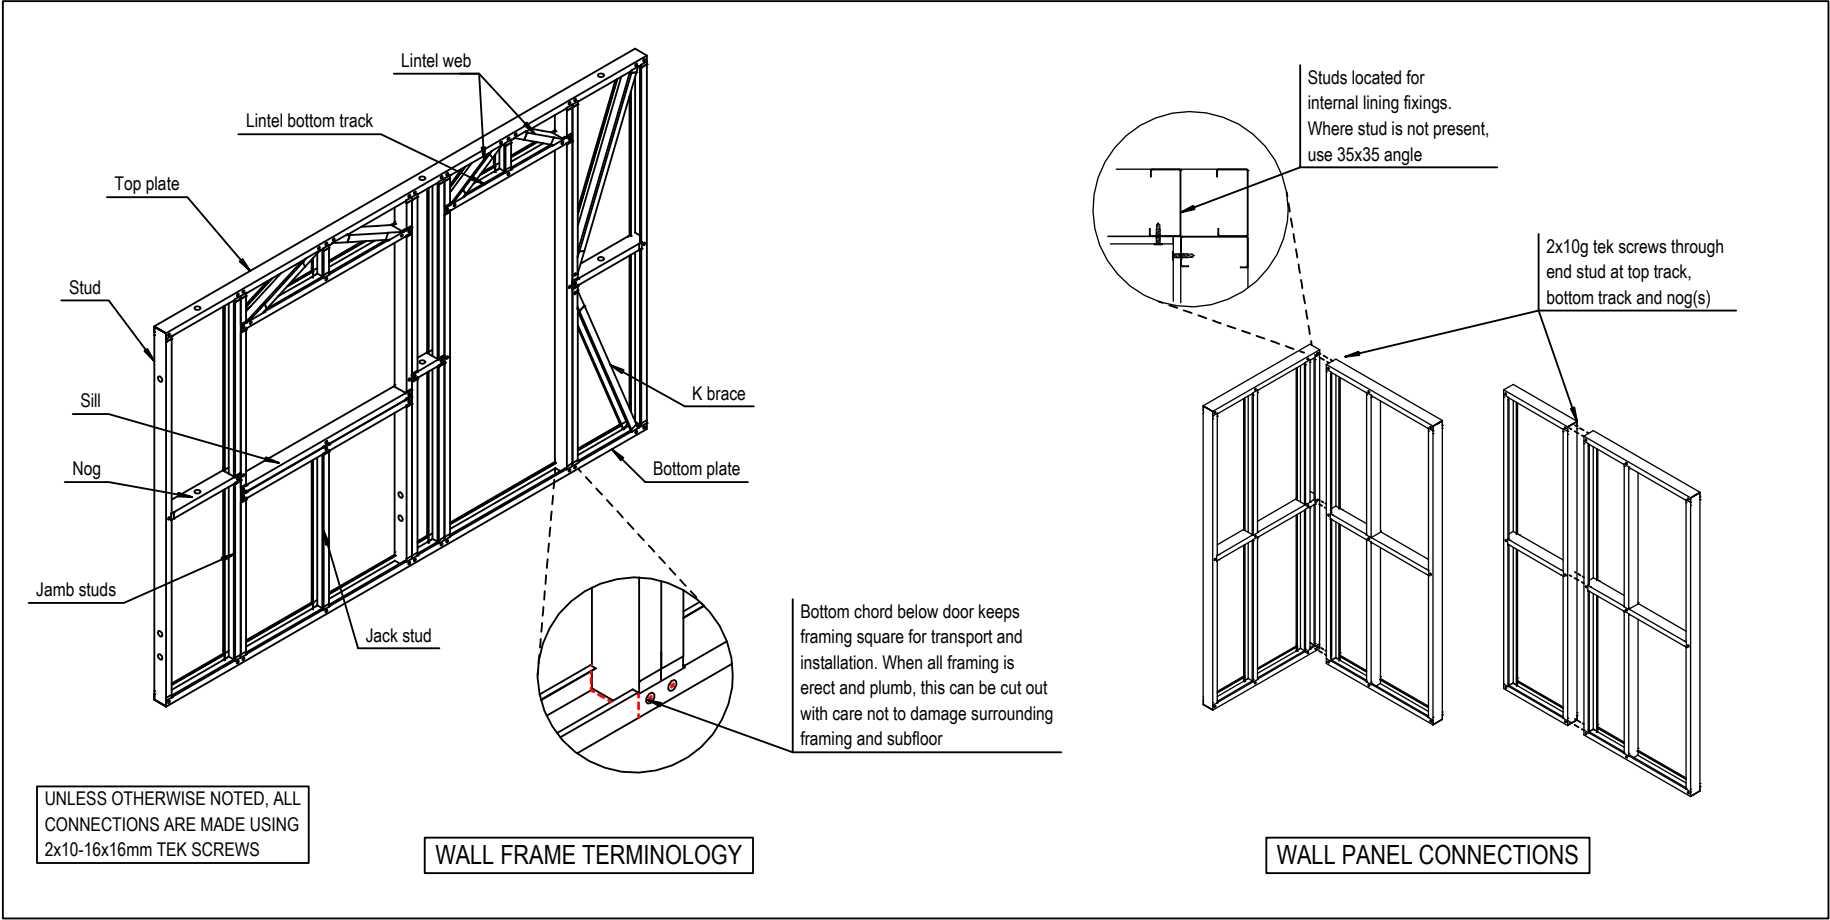

PROPOSED NEW DESIGN FOR SH-2.4x3.6-A SITE ADDRESS TBC	DESIGN PARAMETERS WIND ZONE EH SNOW ZONE <1.5kPa EARTHQUAKE ZONE -- LOT # -- DP --	STEEL FRAME CONSTRUCTION PLANS DETAILS	CONSTRUCTION JOB NUMBER SH-2.4x3.6-A+ info@steelframeman.co.nz	C02 ISSUE DATE 18.11.2024 DETAILER: CT	REVISION A	WALL HOLD DOWN STEEL FRAME MANUFACTURING LIMITED steelframeman.co.nz 0800 178 335 29 Studholme St, Waimate
---	---	--	---	---	-----------------------	--